

## Action Matrix Summary

The NRC provided oversight of 103 operating power reactors using the Reactor Oversight Process (ROP). On average, approximately 75% of the plants were listed in the Licensee Response column of the ROP Action Matrix, which corresponds to the baseline level of NRC oversight. The chart below shows trends in the numbers of plants that are listed in the Regulatory Response, Degraded Cornerstone, Multiple/Repetitive Degraded Cornerstone, and Unacceptable Performance columns of the Action Matrix, which correspond to increasing levels of regulatory engagement with the licensee, plus the number of plants in the MC 0350 process.

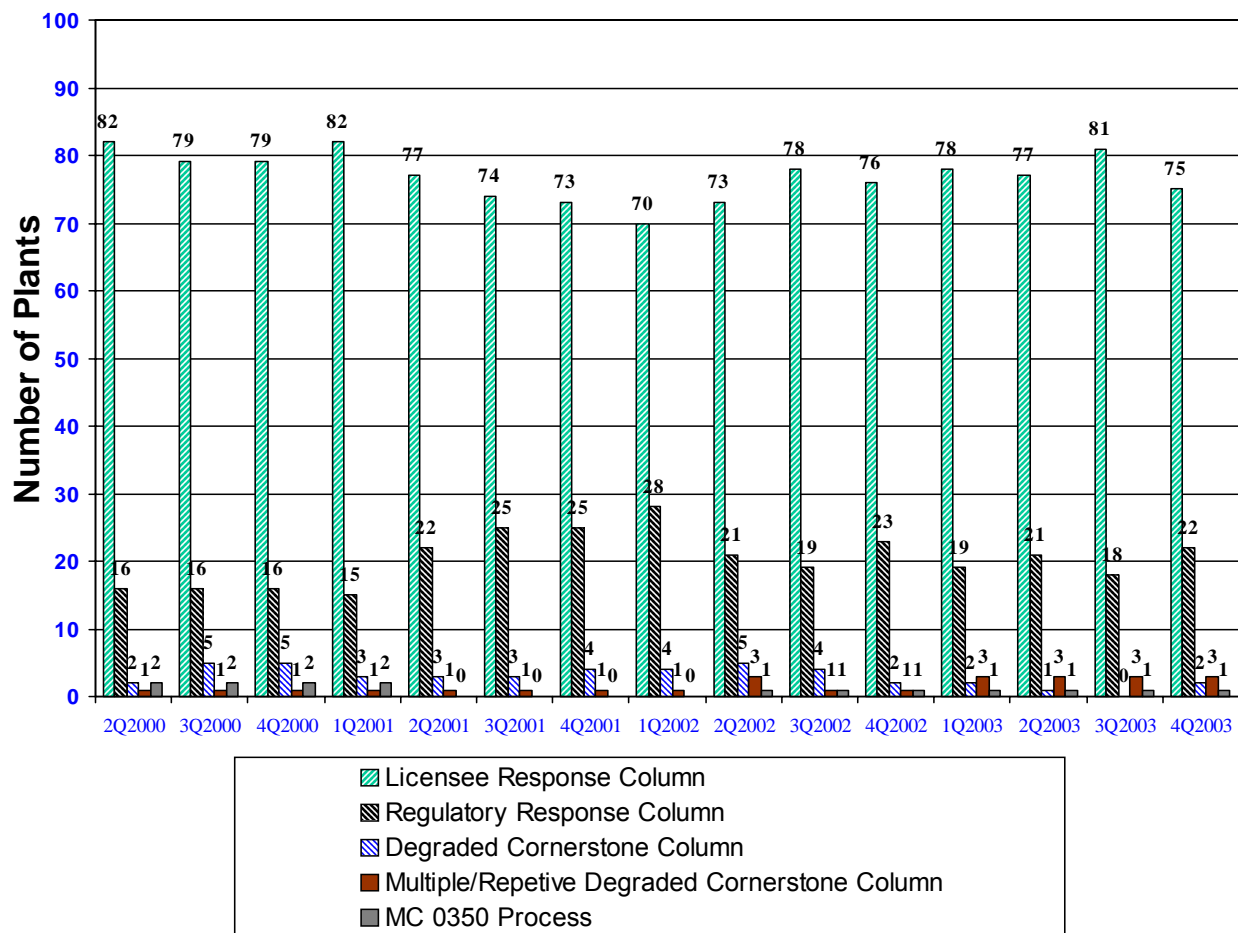


Figure A3-1